



Read these instructions before installation and operation

BF562-5 (24 V DC, 5 A) Installation Instructions



EN 54-4, EN 50131-6 Boxed Power Supply Unit (PSU)




WARNING: THIS PSU MUST BE INSTALLED AND MAINTAINED BY A SUITABLY SKILLED AND TECHNICALLY COMPETENT PERSON. THIS PSU IS A PIECE OF CLASS 1 PERMANENTLY CONNECTED EQUIPMENT AND MUST BE RELIABLY EARTHED.

The BF562-5 is a boxed mains input to regulated DC PSU, providing 5 A @ 24 Vd.c. nominal, designed for use with fire and security systems. Combining the functions of a PSU, battery charging unit and battery monitoring unit, it is fully compliant with EN 54-4 + A1 + A2 and has been built to comply electrically/environmentally with EN 50131-6 (Type A, up to Grade 4 #1, Environmental Class II). The PSU is an approved product by BRE and VdS.

All wiring must be installed in accordance with all applicable national, regional or local standards. In the UK this is BS 7671 (IET Wiring Regulations). Fuses must comply with IEC/EN 60127-2. See Fig.1 for PSU connection details.

Fig.1 - PSU Layout & Connections

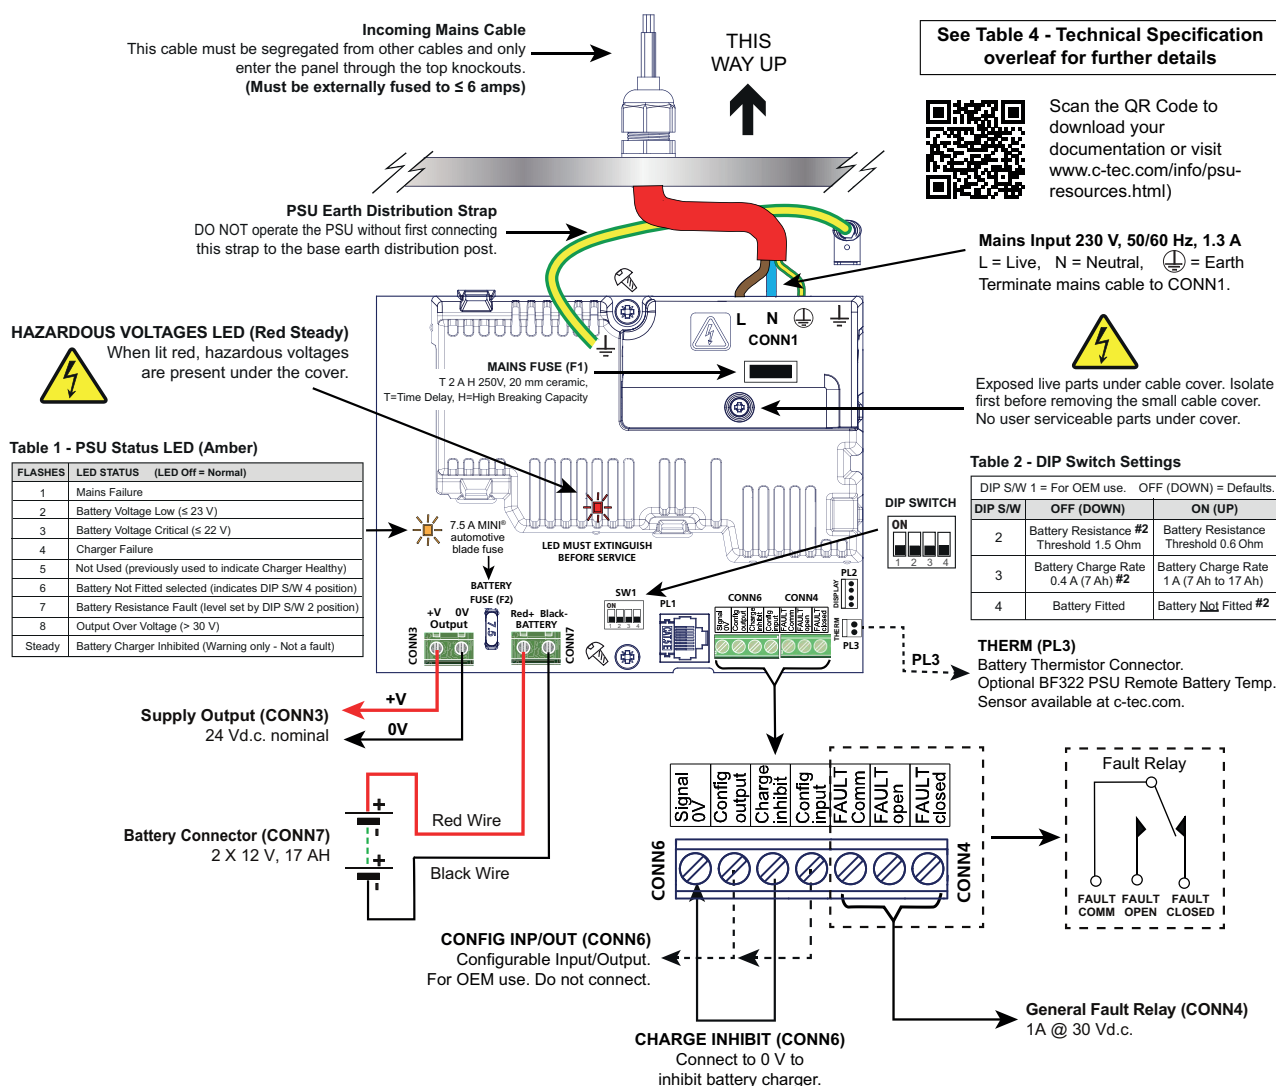

Note: On a standard 'as-supplied' unit, DIP Switch 4 ('Battery Not Fitted') is OFF (DOWN) and a fault will occur on initial power-up if fully charged batteries are NOT connected. See Table 2 - DIP Switch Settings (Fig.1).

Over Current / Over Load Protection: If the output load attempts to pull current in excess of the PSU rating, the PSU will shut-down and attempt to auto-recover after approx. 10 seconds, and will continue to do so until the overload is removed. If the PSU is subjected to a short circuit across the output terminals, the PSU may trip and require power cycling to reset. Reset by switching off mains and disconnecting the batteries, then wait for the red 'Hazardous Voltage Present' LED to extinguish before re-applying mains and batteries. Check the battery fuse (F2) has not operated.



WARNING: There is a risk of explosion if an incorrect battery type or size is used. Always dispose of used batteries in accordance with the battery manufacturers instructions and local regulations. Batteries are heavy and can produce dangerously high currents if shorted. Take care when handling and routing battery leads to avoid damage. The batteries must be safely secured by the cable ties (supplied in the accessories).

Important Note about Batteries: This PSU complies with EN 54-4 and therefore must monitor and report battery resistance faults when batteries are fitted. The battery resistance fault threshold is directly related to the ability of the batteries to deliver the rated current to the load.

VRLA battery resistance varies with manufacturer quality, battery age (from date of manufacture, particularly if left uncharged during shipping or storage), temperature, size and state of charge. It is not uncommon for so called “new” batteries to be in excess of six months old if the supply chain is not properly managed. It is therefore important to fit good quality, new batteries that have not been shelf soiled during shipment or storage. VRLA battery resistance naturally increases in cold environments and may make marginally usable batteries at room temperature unusable at low temperatures. Careful siting of the product may alleviate some of the natural limitations of VRLA batteries. Smaller batteries have a higher resistance than larger batteries as shown in Table 3 right.

VRLA battery life is typically rated at 20°C. Raising the temperature by 10°C will halve the expected usable life of a VRLA battery. Operating at 40°C will therefore lead to only a quarter of the expected life. High temperature also degrades battery life during shipping and storage.

Table 3 - Battery Resistance

VRLA Battery	Typical Battery Resistance (single battery, x2 for 24 V systems)
12 V, 2 Ah	280 mΩ
12 V, 3.2 Ah	100 mΩ
12 V, 7 Ah	85 mΩ
12 V, 17 Ah	65 mΩ
12 V, 38 Ah	58 mΩ

Table 4 - Technical Specification

POWER SUPPLY SPECIFICATION: BF562-5 (24 V DC, 5 A)		
Mains supply voltage (a.c.):	230 V _~ , 50/60 Hz. Rated current: 1.3 A r.m.s.	
Maximum output current:	5 A	
Output current / power rating:	4.6 A continuous 'I max a' if DIP Switch 3 OFF (DOWN) #2	
	4 A continuous 'I max a' if DIP Switch 3 ON (UP)	
	Taking a load current greater than 'I max a' will temporarily reduce the battery charge current	
Output voltage:	5 A 'I max b', battery charger turned off via CONN6	
	'I min' = 0 mA	
Battery characteristics:	20 V ('V min') to 30 V ('V max') ± 2% ≤ 320 mV ripple pk-pk	
	Discharge cut-off: 21 V ± 2%	
	Float charge voltage: 27.3 V ± 1% @ 20°C	
Maximum approved VRLA battery size:	Up to 2 x 17 Ah	
Battery charge capacity (C):	7 Ah up to 17 Ah (battery charged to 80% of capacity in 24 hrs)	
Maximum internal battery resistance 'Ri max':	1.5 Ω if DIP Switch 2 OFF (DOWN) #2	0.6 Ω if DIP Switch 2 ON (UP)

CONNECTIONS	
Mains Input (CONN1):	Mains supply input terminals: Live, Neutral & Earth. 1 mm ² to 2.5 mm ² cable size.
Supply Output (CONN3):	Output for auxiliary equipment. 1 mm ² cable size, <30 m cable length (screened cable must be used).
Battery Connector (CONN7):	Connection to the VRLA batteries. 1 mm ² cable size.
Fault Relay (CONN4):	Isolated changeover relay output, rated 1 A @ 30 Vd.c., 1 mm ² cable size <30 m cable length (screened cable must be used). CONN4 should not be used for compliance with EN 50131-6, PL2 provides serial data for all fault signals.
Battery Charge Inhibit (CONN6):	Connect to 0 V to inhibit battery charger. 1 mm ² cable size.
CONF Input / Output (CONN6):	For OEM use.
PL2:	Serial Data Connector. Protocol available via C-TEC Technical. Optional BF423 configurator tool available at c-tec.com .
PL3:	Battery Thermistor Connector. Optional BF322 PSU Remote Battery Temperature Sensor available at c-tec.com .

INDICATORS	
3 x Front Panel Indicators:	<p> (Green Steady LED) - The Supply Output (CONN3) is healthy and within range (Amber Steady LED) - A fault is present on the PSU (Amber LED) - A fault with an auxiliary unit (user-definable), 20 to 30 V, 3.5 to 7 mA. </p>
2 x Power Supply PCB LEDs:	<p>Hazardous Voltages Present (Red Steady LED)</p> <p>PSU Status (Amber Flashing LED), see Table 1 - PSU Status LED (Fig.1)</p>

PHYSICAL	
Dimensions:	404 mm (W) x 404 mm (H) x 110 mm (D)
Weight / Construction:	5 kg (without batteries) / Metal lid and base
Enclosure finish:	RAL7035 textured

FITMENT & OPERATING CONDITIONS	
Five mounting holes are provided for Ø4-5 mm CSK screws. Mount ≤2 m on a vertical surface. Wall condition, construction and in-service weight must be considered when choosing screw fixings. For compliance with EN 54-4 the PSU must be closely coupled with the CIE. The PSU enclosure has an IP30 rating (to EN 60529) and is designed for indoor use only . The components are selected to operate within their specification when the environmental conditions outside the enclosure comply with class 3k5 of the latest edition of IEC 721-3-3. Temperature range: -10°C to +40°C. Maximum humidity: 95% non condensing.	

CERTIFICATES & DECLARATION OF PERFORMANCES to EU No. 305/2011, CPR (Certificates and DoPs are available for download at c-tec.com)		
VdS Approval No.: G220016	LPCB Certificate No.: 176p	
Declaration of Performance: DOP0000064	CPR Certificate No.: 2831-CPR-F2656	EN 54-4:1997 + A1:2002 + A2:2006

E&OE. No responsibility can be accepted by the manufacturer or distributors of these power supplies for any misinterpretation of this instruction, or for the compliance of the system as a whole. The manufacturers policy is one of continuous improvement and we reserve the right to make changes to product specifications at our discretion and without prior notice.



Manufacturer: Computationics Limited (C-TEC), Challenge Way, Martland Park, Wigan, Lancashire WN5 0LD. www.c-tec.com
 Niederlassung Deutschland: C-TEC Germany Limited, Virchowstr. 32, D-33332 Gütersloh. www.c-tec-germany.de